Compact Pressure Switch

Series ZSE1 (For Vacuum)/ISE1 (For Positive Pressure)

For General Pneumatics





Can be integrated with ZM ejector system.



Variable hysteresis


1 to 10% of set pressure (Variable)

Easy and simple wiring

Connector type



Compact Pressure Switch Series ZSE1/ISE1

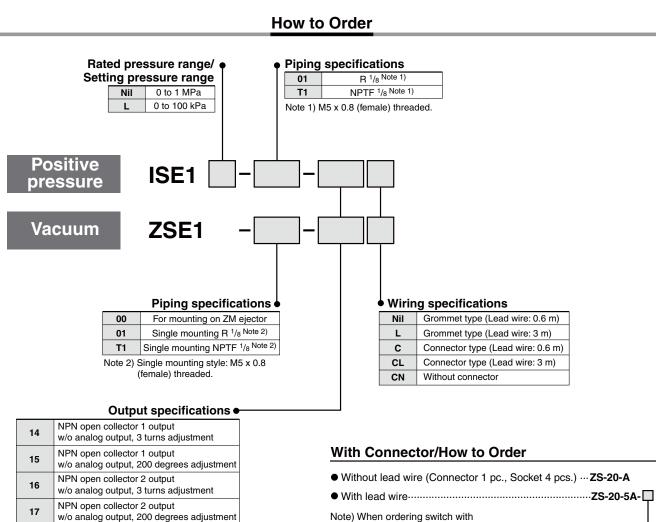

NPN open collector 1 output

PNP open collector 1 output

w/analog output, 3 turns adjustment
NPN open collector 1 output

w/analog output, 200 degrees adjustment

w/o analog output, 200 degrees adjustment

18

19

55

Note) When ordering switch with 5 m long lead wire, indicate

both part numbers.

•	
Ex.) ZSE1-01-15CN1 p ZS-20-5A-501 p	

ead	wire i	ength •
	Nil	0.6 m
	30	2 m

50

5 m

ZSE30 ISE30 ZSE40

ISE40

ISE₁₀

ISE70

ZSE80 ISE80

ZSP

PS

ISA2

PSE

IS

ISG

ZSM1

Series ZSE1/ISE1

Specifications

For details about the Pressure Switch Precautions, refer to pages 763 and 764. For details about the Specific Product Precautions, refer to the Operation Manual at SMC website.


Model		ZSE1	ISE1L	ISE1			
		For vacuum	For low pressure	For high pressure			
Rated pressure range/Set pressure range		0 to -101 kPa	0 to 100 kPa	0 to 1 MPa			
Expanded analog output range			10 to 0 kPa	-10 to 0 kPa	-0.1 to 0 MPa		
Proof pressure			500 kPa 1.5 MPa				
Fluid			Air/Non-corrosive, non-flammable gas				
Power supply	voltage	•	12 to 24 VDC ±10%, Ripple (P-P)10% or less (With power supply polarity protection)				
Current consi	umption	1	1 output: 17 mA or less at 24 VDC, 2 output: 25 mA or less at 24 VDC				
Response tim	ie		5 ms or less				
Repeatability			±1% F.S. or less				
Resistance Enclosure Operating temperature range			IP40				
			Operating: 0 to 60°C, Stored: –10 to 60°C (With no condensation and no freezing)				
Operating humidity range			Operating/Stored: 35 to 85%RH (With no condensation)				
Temperature of	characte	ristics (Based on 25°C)	25°C) ±3% F.S. or less				
Withstand vol	ltage		1000 VAC for 1 min. (between terminals and housing)				
Insulation res	istance		50 $\mathrm{M}\Omega$ or more (500 VDC measured via megohmmeter) between terminals and housing				
Port size			01: R 8, M5 x 0.8 T1: NPTF 1/8, M5 x 0.8 00: ZM ejector mount type				
Weight			40 g (Including 0.6 m-Long lead wire)				
Lead wire Grommet type		Oilproof heavy-duty vinyl cable -14, -15, -55 : 3 cores ø3.4, Conductor area: 0.2 mm², Insulator O.D.: 1.1 mm -16, -17, -18, -19: 4 cores ø3.5, Conductor area: 0.14 mm², Insulator O.D.: 1.0 mm					
Connector type			Heat-resistant vinyl electric wire, 4-wire, Conductor area: 0.3 mm², Insulator O.D.: 1.55 mm				
Standard			CE, RoHS				

Output Specifications

Model	-14	-15	-16	-17	-18	-19	-55
Switch output	NPN open collector 30V, 80 mA or less PNP open collect 80 mA or less				PNP open collector 80 mA or less		
Residual voltage	1V or less (With load current of 80 mA)						
Number of outputs	1 2		1				
Hysteresis	1 to 10% of set	t prss. (Variable)	3% F.S. or	less (Fixed)	1 to 10% of set	prss. (Variable)	1 to 10% of set press. (Adjustable)
Indicator light		output is ON ed)		output is ON OUT2: Green)	ON:	when output i	is ON
Trimmer adjustment	3 turns	200 degrees	3 turns	200 degrees	3 turns	200 de	egrees
Analog output	None			1 to 5 V \pm 5% F.S. or less (At rated pressure range) 0.6 to 1 V \pm 7% F.S. or less (At set pressure range) Output impedance: Approx. 1 k Ω		None	

Analog Output

1 to 5 VDC



Rated pressure range	Α	В	С
For vacuum 0 to -101 kPa	0	-101 kPa	10.1 kPa
For low pressure 0 to 100 kPa	0	100 kPa	–10 kPa
For positive pressure 0 to 1 kPa	0	1 MPa	-0.1 MPa




Calibration Procedure

- Set the ON-pressure by the pressure setting trimmer. Turning clockwise can set the high pressure/high vacuum pressure.
- In the event of setting, use a flat head screwdriver suited for the groove of a trimmer, and rotate it lightly with a fingertip.


¹_z SE1(L)-□□-14/-15/-18/-19

- Switches with variable hysteresis can be adjusted by means of the HYS potentiometer in the range 1 to 10% of the setting pressure range.
- Readjust the ON-pressure setting when the hysteresis setting trimmer was changed after setting the ON pressure.




¹ SE1(L)-□□16/-17

- With pressure setting trimmer 1 (SET 1), OUT 1 (Black lead wire, Red LED) can be set.
- With pressure setting trimmer 2 (SET 2), OUT 2 (White lead wire, Green LED) can be set.



 Set the possible min. pressure for adsorption confirmation. If setting the pressure lower than that, switch becomes ON in case that adsorption is not completely done. If setting the pressure higher than that, switch does not become ON even though it may absorb workpieces.



Regarding the pressure setting

⚠ Caution

Observe the following precautions for setting the vacuum pressure:

Use your fingertips to gently turn the screwdriver.

Do not use a screwdriver with a large grip or with a tip that does not fit into the trimmer groove because this could strip the groove.

Hysteresis

Hysteresis is the pressure difference between the ON and the OFF pressure of the output signal. The set pressure is the pressure selected to switch from OFF to ON condition.

ZSE30

ISE30

ZSE40

ISE40

ISE₁₀

ISE70 ZSE80

ISE80

ZSE□ ISE□

ZSP

PS


ISA2

PSE

IS

ISG


ZSM1



How to Use Connector


1. Attaching and detaching connectors

- When assembling the connector to the switch housing, push the connector straight onto the pins until the lever locks into the housing slot.
- When removing the connector from the switch housing, push the lever down to unlock it from the slot and then withdraw the connector straight off of the pin.



2. Crimping of lead wires and sockets

Strip 3.2 to 3.7 mm at the end of the lead wires, insert the ends of the core wires evenly into the sockets, and then crimp with a crimping tool. When this is done, take care that the coverings of the lead wires do not enter the core wire crimping area. (Crimping tool: model no. DXT170-75-1)




3.Attaching and detaching lead wires with sockets

Attaching

Insert the sockets into the square holes of the connector (with +, 1, 2, – indication), and continue to push the sockets all the way in until they lock by hooking into the seats in the connector. (When they are pushed in their hooks open and they are locked automatically.) Then confirm that they are locked by pulling lightly on the lead wires.

Detaching

To detach a socket from a connector, pull out the lead wire while pressing the socket's hook with a stick having a thin tip (about 1 mm). If the socket will be used again, first spread the hook outward.









Compact Pressure Switch Series ZSE1/ISE1

Internal Circuits and Wiring Examples

-14/-15 NPN (1 output)

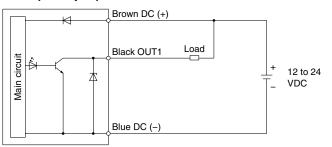

-16/-17 NPN (2 outputs)

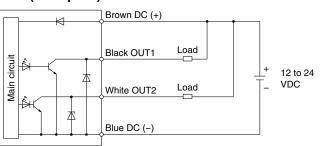

ZSE30 ISE30 ZSE40 ISE40

ZSE10 ISE10

ZSE80 ISE80

ZSE□ ISE□

ZSP

PS

L9

ISA2


PSE

IS


ISG

ZSM1

-18/-19 NPN (1 output) + Analog voltage output

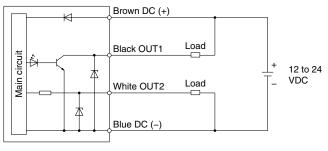


-55 PNP (1 output)

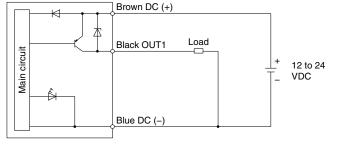


Series ZSE1/ISE1

Dimensions

Grommet type: ZSE1-00-14/-15/-18/-19

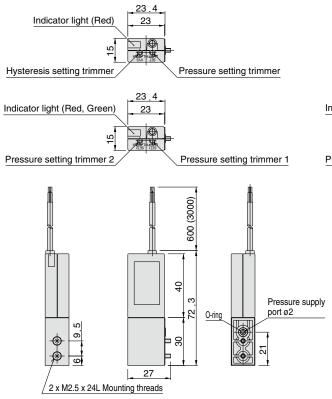


Connector type: ZSE1-00-14C/-15C/-18C/-19C

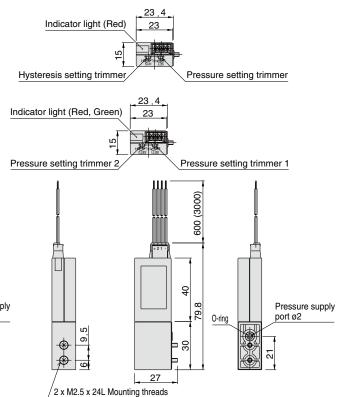


Grommet type:

L SE1-01 -14/-15/-18/-19




Connector type:

L SE1-01 -14C/-15C/-18C/-19C



¹_zSE1-01-16/-17

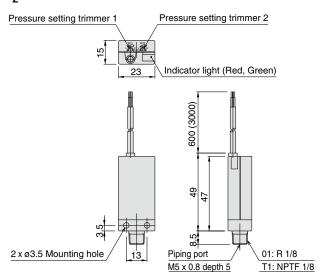

^I_z SE1-01-16C/-17C

